

Panasonic Series

Configuration for the RS-232 connection is shown in Figure 2-1-29.

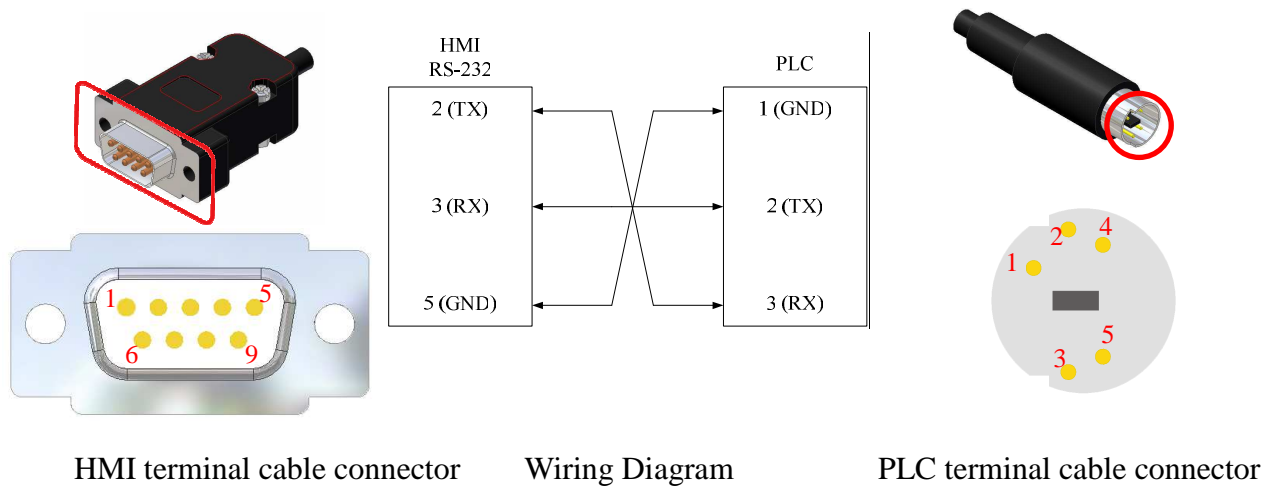


Fig. 2-1-29 Panasonic Series Connection

Recommended serial setup :

Type	Baud Rate (Bps)	Parity	Data Length (Bit)	Stop Bit (Bit)	PLC Station NO.
FP0FP-eFPE	9600	Odd	8	1	N/A
FP-X	19200				
FP2	115200				