


■ D-Sub9 Profibus Kit Instruction



Please remove rubber band
before installing the D Sub 9
Profibus Kit.

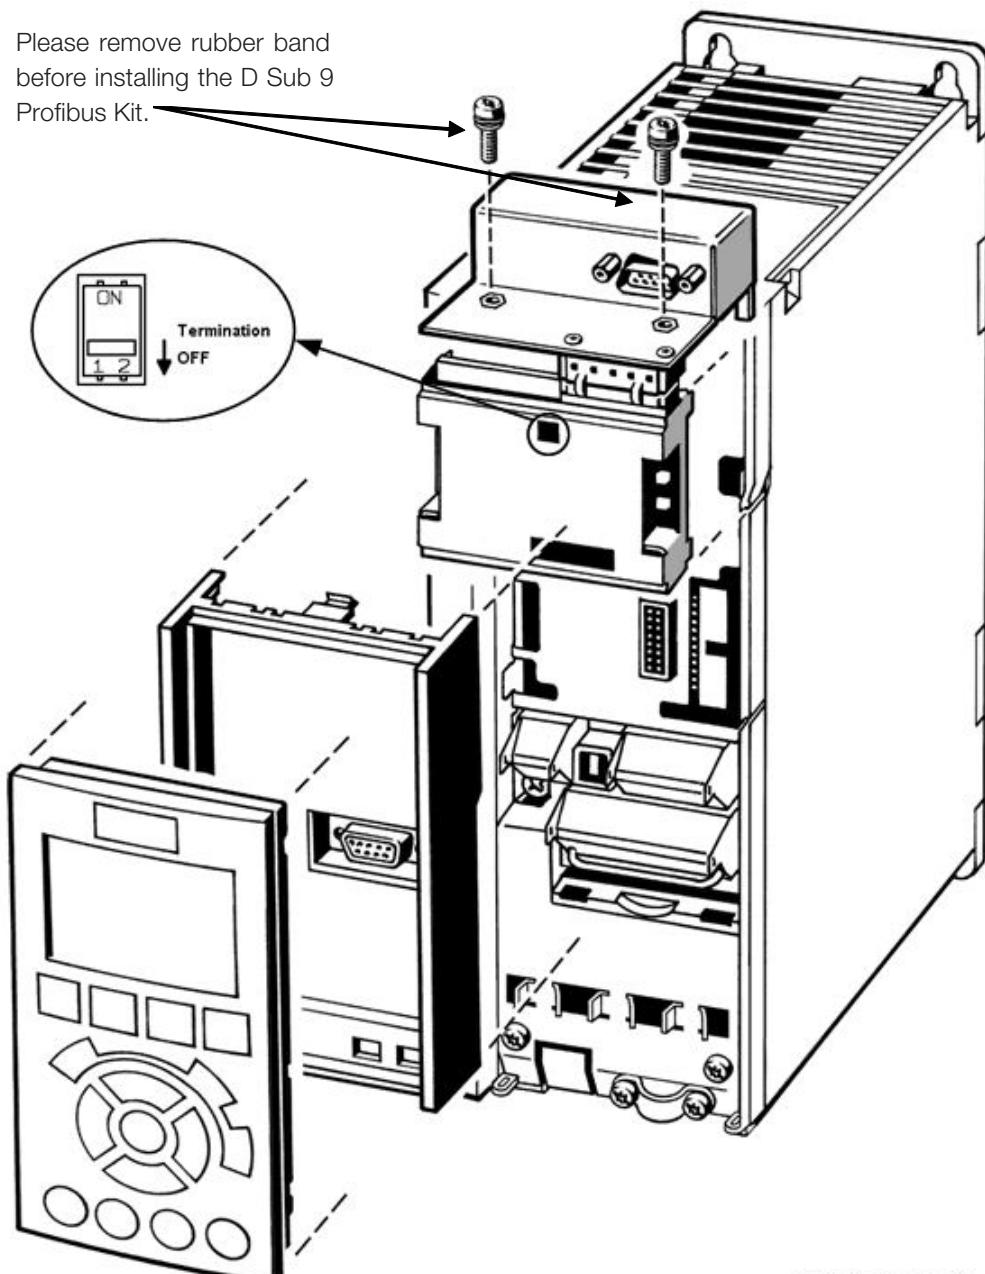

130BT453

D-sub 9 Pin N°	Signal
1	Not connected
2	Not connected
3	Rx/Tx +
4	CS
5	GND
6	5 V bus
7	Not connected
8	Rx/Tx -
9	Not connected



D-Sub9 Profibus Kit Instruction

efesotomasyon.com

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequent changes being necessary in specifications already agreed.
All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

